


02-0020-004-0516-EN We reserve the rights for technical changes!

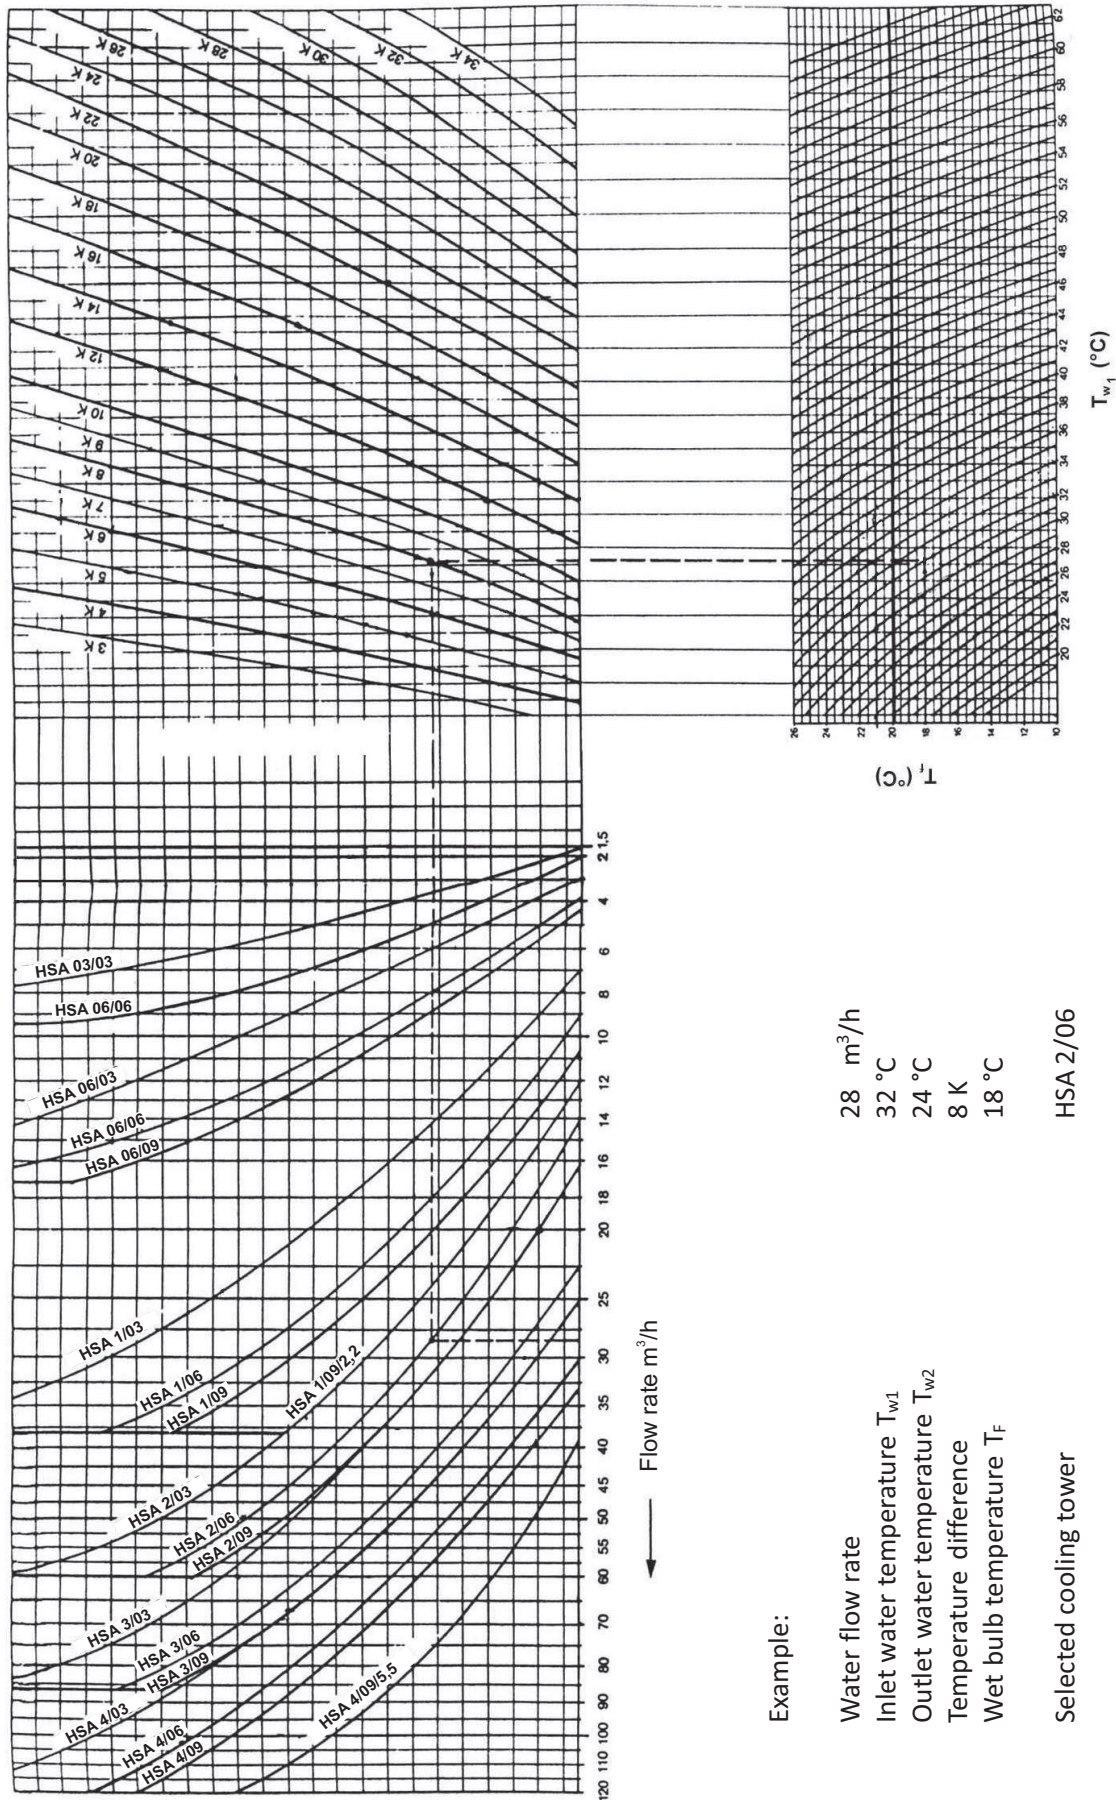

Example:

Water flow rate 28 m³/h  
 Inlet water temperature  $T_{w1}$  32 °C  
 Outlet water temperature  $T_{w2}$  24 °C  
 Temperature difference 8 K  
 Wet bulb temperature  $T_F$  18 °C  
 Selected cooling tower HSA 2/06

Cooling tower  
 HSA 03 + 4

The diagram for type  
 and size selection of the  
 cooling tower type HSA

ESOT - Invest d.o.o.  
 Kersnikova ulica 19  
 3000 Celje