


02-0020-005-0516-EN We reserve the rights for technical changes!

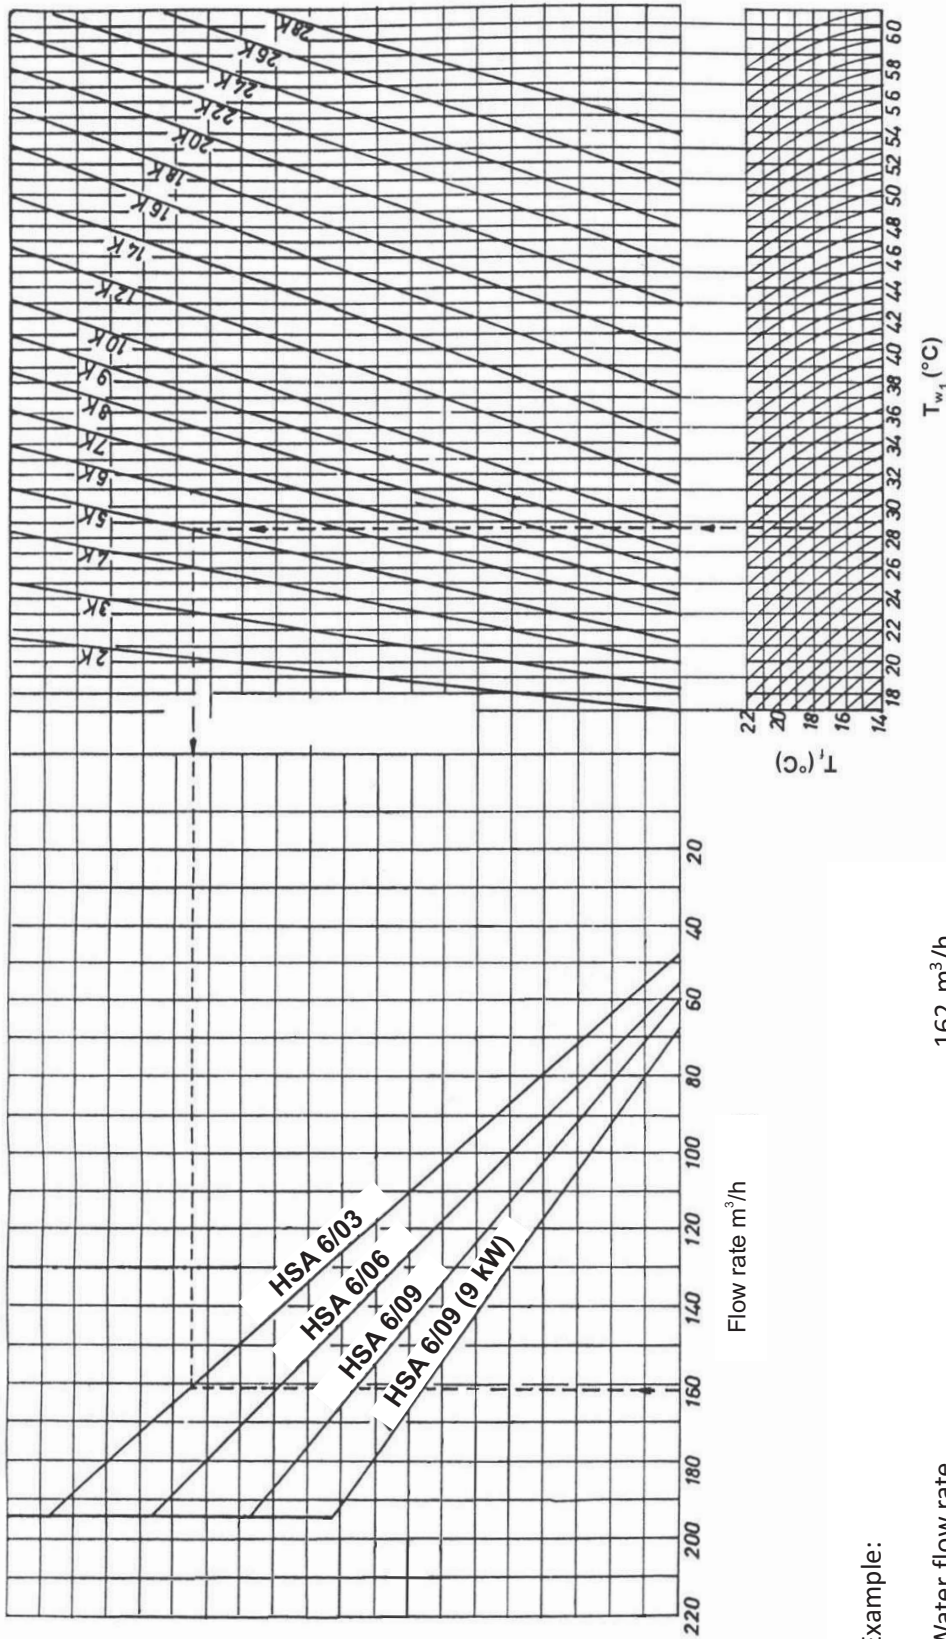

Example:

- Water flow rate: 162 m^3/h
- Inlet water temperature T_{w1} : 31 °C
- Outlet water temperature T_{w2} : 26 °C
- Temperature difference: 5 K
- Wet bulb temperature T_F : 18 °C

Selected cooling tower: HSA 6/03

ESOT - Invest d.o.o.
Kersnikova ulica 19
3000 Celje

The diagram for type and size selection of the cooling tower type HSA

Cooling tower
HSA 6